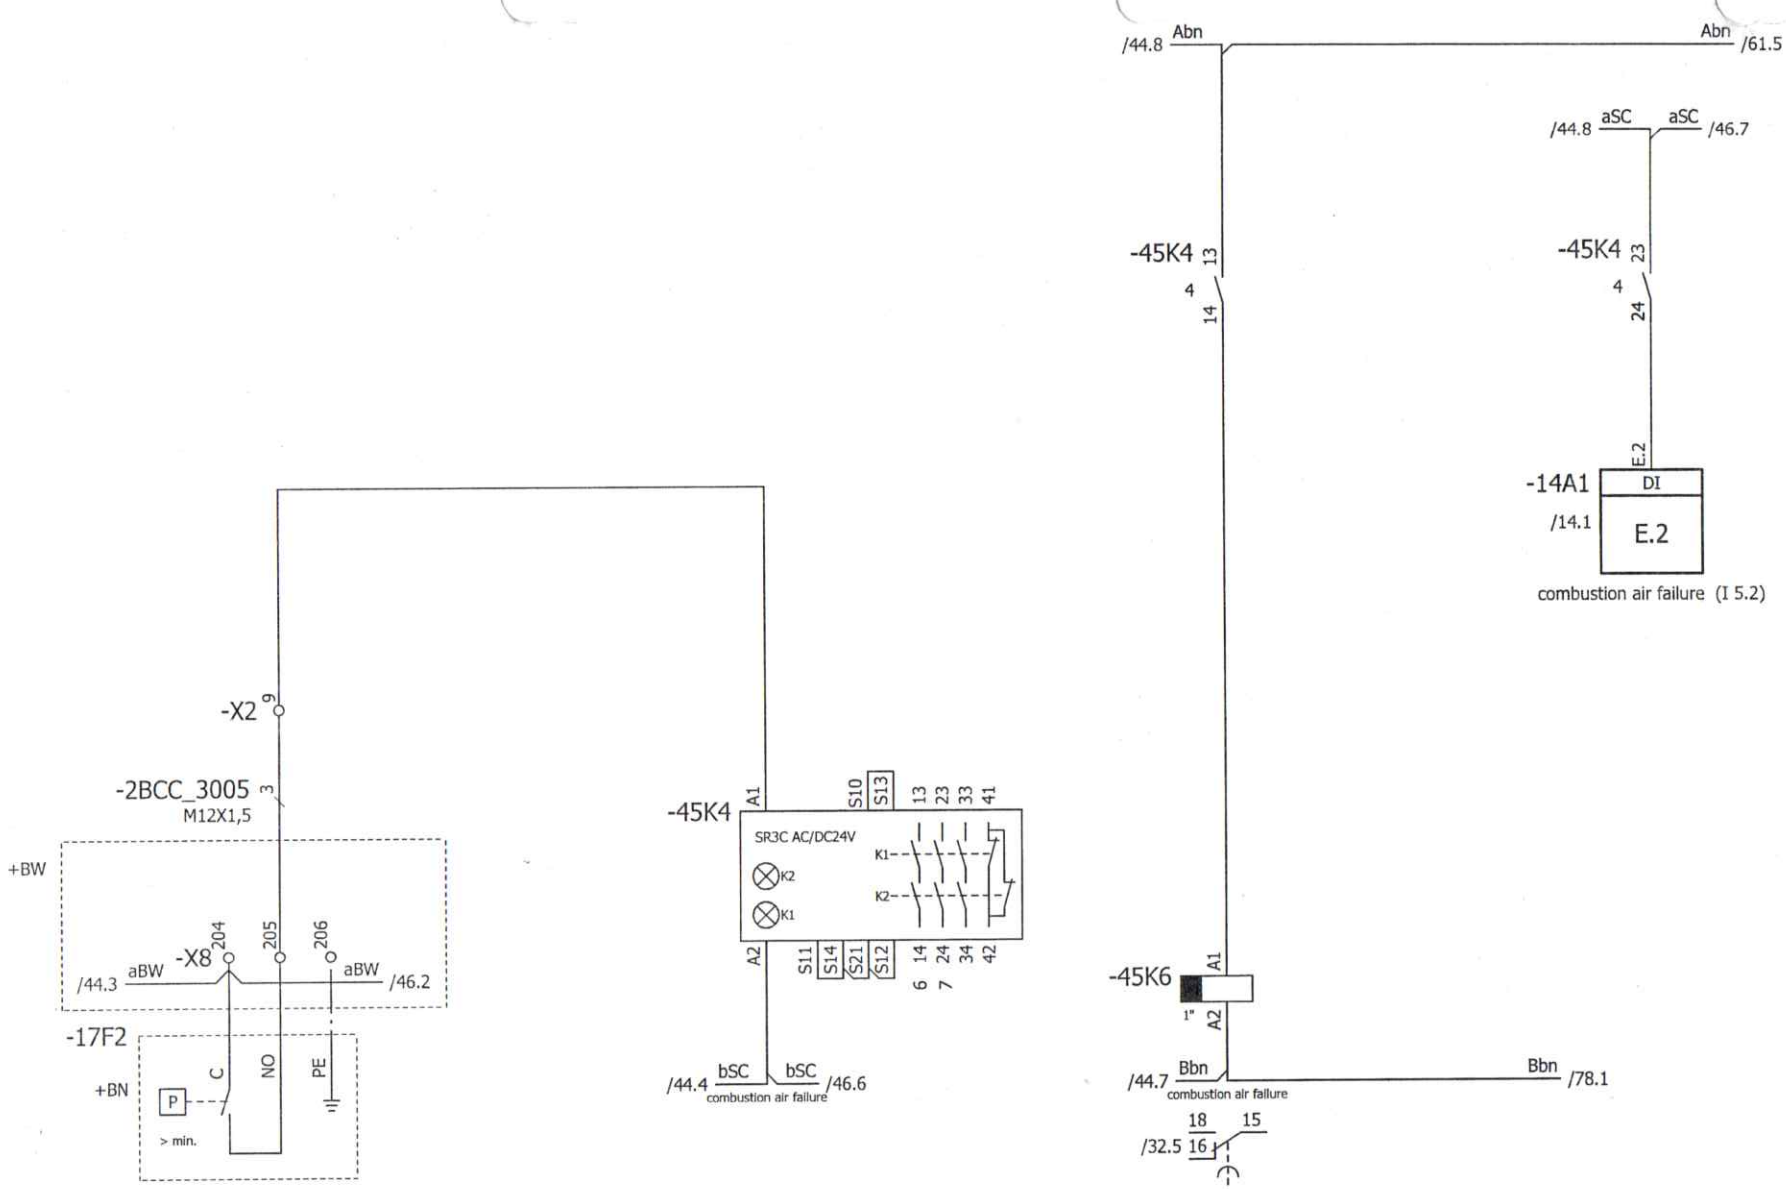

protection note according to ISO 16016 consider!

all lines without indication of cross section are H07Z-K 1,5mm²

04.03

2	finals	21.06.2012	ROS	date	2010-07-08	AUX. BOILER 2 FMB-H-15/7	SAACKE VKK MARINE BOILERS GMBH SAACKE MARINE SYSTEMS	circuit diagram / Stromlaufplan 45
1	rename SY	21.06.2011	ROS	drawn	ROS			
0	as built	30.07.2010	ROS	check	ROS			
R.	modification	date	name	standard		origin	replaced for	replaced by

combustian air pressure

0-9001-070198-61/ 3-32 =2BCC +CC_M

0-9001-070198-61-3

sheet 45 / 82 sh.