


protection note according to ISO 16016 consider!

all lines without indication of cross section are H07Z-K 1,5mm<sup>2</sup>

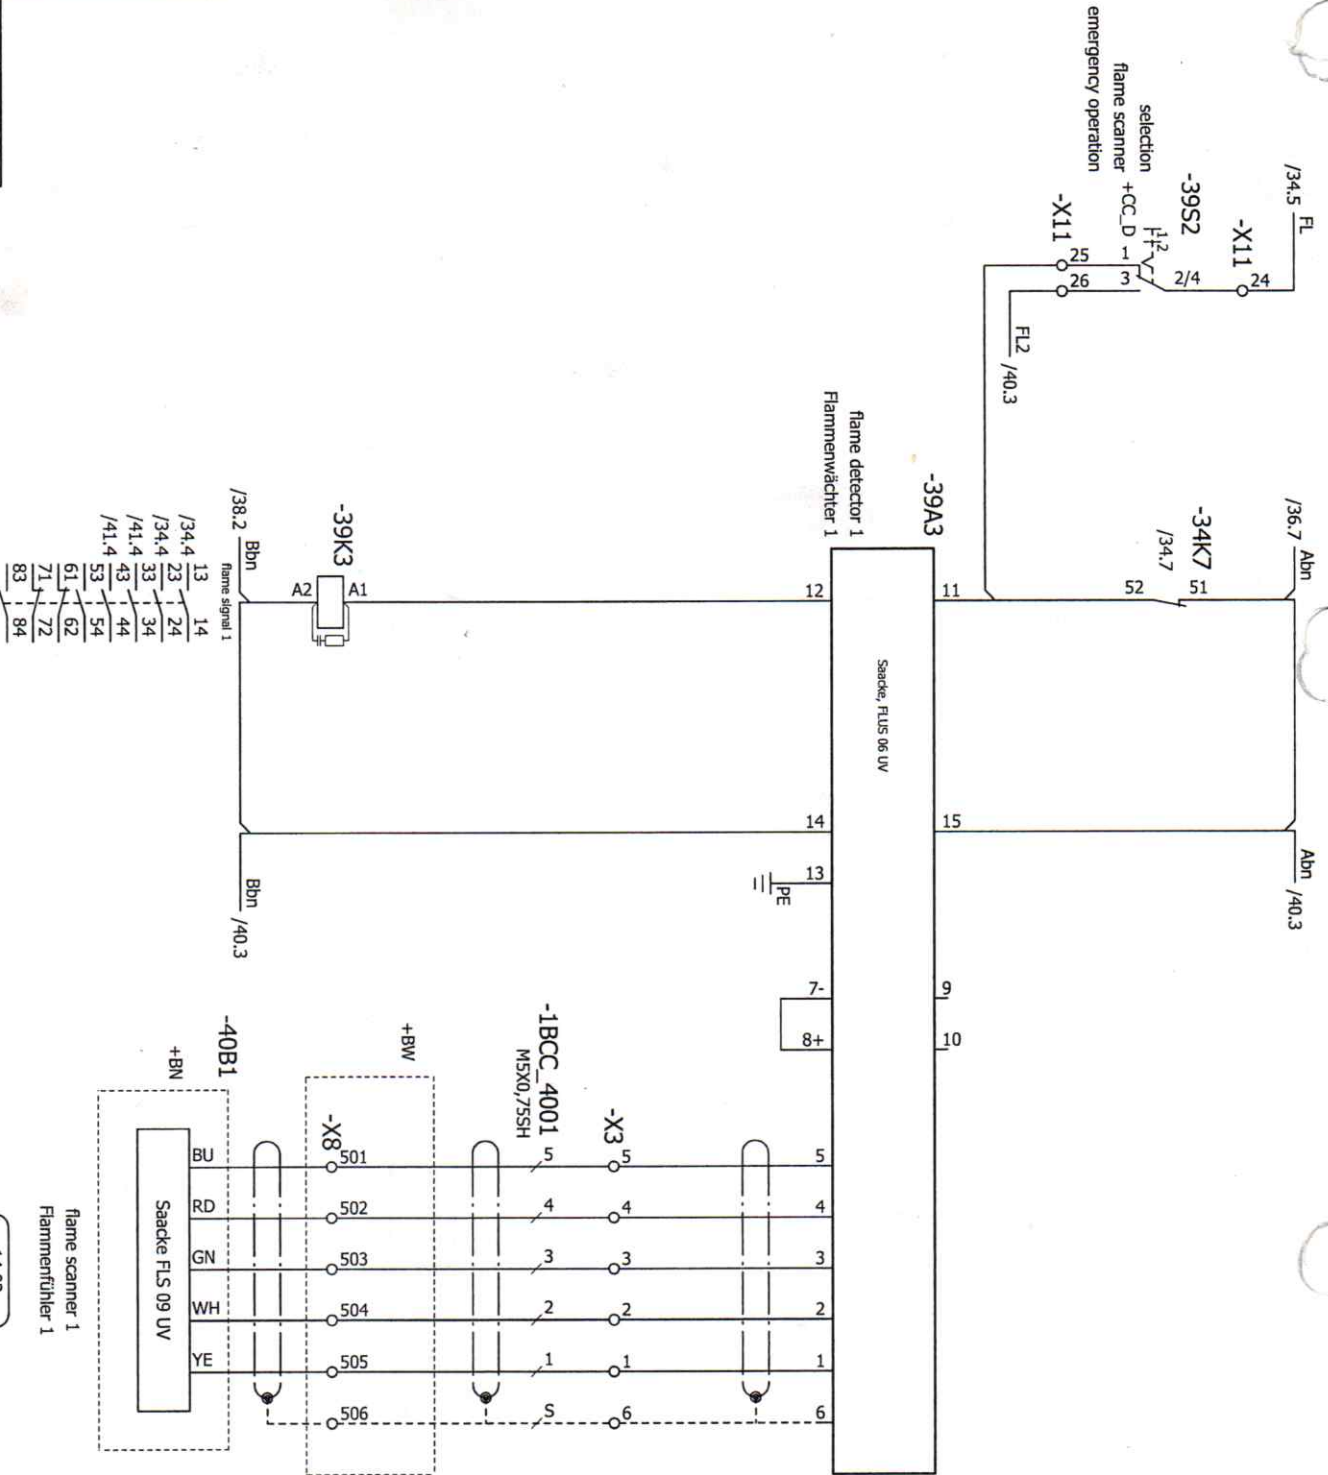

Die Verlegung der Fühlerleitung muß räumlich getrennt von Netz- und Steuerleitungen sowie energiereichen Starkstromleitungen bzw. -einrichtungen (z.B. Zündleitungen, Zündtrafes, Elektromotoren, Schütze) erfolgen. Eine parallele Leitungsführung zu Netzleitungen in Kabelkanälen ist nicht zulässig. Die Installation der Probe line must be separate from the supply and control mains as well as from the power lines and high voltage systems (e.g. ignition lines, ignition transformers, electric motors, contactors). A parallel line arrangement to the supply lines in the cable ducts is not admissible.

2	Finals	21.06.2012	ROS	date	2010-07-08	origin	AUX. BOILER 1 FMB-H-15/7	replaced for	replaced by	SAACKE	circuit diagram / Stromlaufplan	Flame detection 1	0-9001-070198-60/ 3-32	=1BCC +CC M	sheet: 39
1	rename SY	21.06.2011	ROS	drawn	ROS								0-9001-070198-60-3		75 stl.
0	as built	30.07.2010	ROS	check	ROS										
R	modification			name standard											

- 13 14
- 13 14
- 23 24
- 33 34
- 43 44
- 53 54
- 61 62
- 71 72
- 83 84

flame scanner 1  
Flammenfühler 1  
14.02